

# INSTALLATION REPORT BASS LAKE

## Z-92<sup>®</sup> URANIUM REMOVAL

BASS LAKE WATER COMPANY  
BASS LAKE, CALIFORNIA

Design Flow: 125 GPM

Located approximately 55 miles north of Fresno in the Western Sierra Mountains. Uranium levels average 144 pCi/L. No other treatment, only the addition of chlorine and polyphosphate.

ON-LINE SYSTEM START DATE:

June 2007




Clean water. Clean earth. That's our promise. <sup>®</sup>

# INSTALLATION REPORT BASS LAKE



## ON-LINE RESULTS

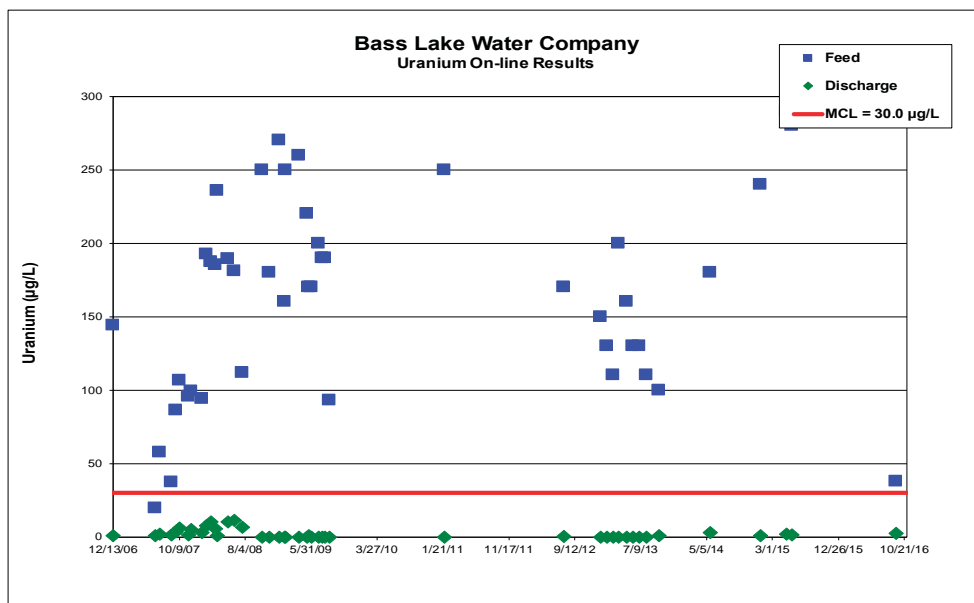

FOR MORE  
INFORMATION CONTACT:

WRT  
RON DOLLAR  
303.424.5355 OR VISIT:  
[WWW.WRTNET.COM](http://WWW.WRTNET.COM)

BASS LAKE WATER COMPANY  
STEVE WELCH  
559.642.2494