

INSTALLATION REPORT CORTLAND

Z-88® RADIUM REMOVAL

TOWN OF CORTLAND, ILLINOIS

Two existing treatment plants
Design Flows: 550 GPM & 1,150 GPM

Located 65 miles west of Chicago, current population approximately 2,100. Average radium levels approximately 12.5 pCi/L. No other treatment, only the addition of chlorine and polyphosphate.



ON-LINE SYSTEM START DATE:

Well No. 3 October 2006


Well No. 4 October 2010



Clean water. Clean earth. That's our promise.®



ON-LINE RESULTS

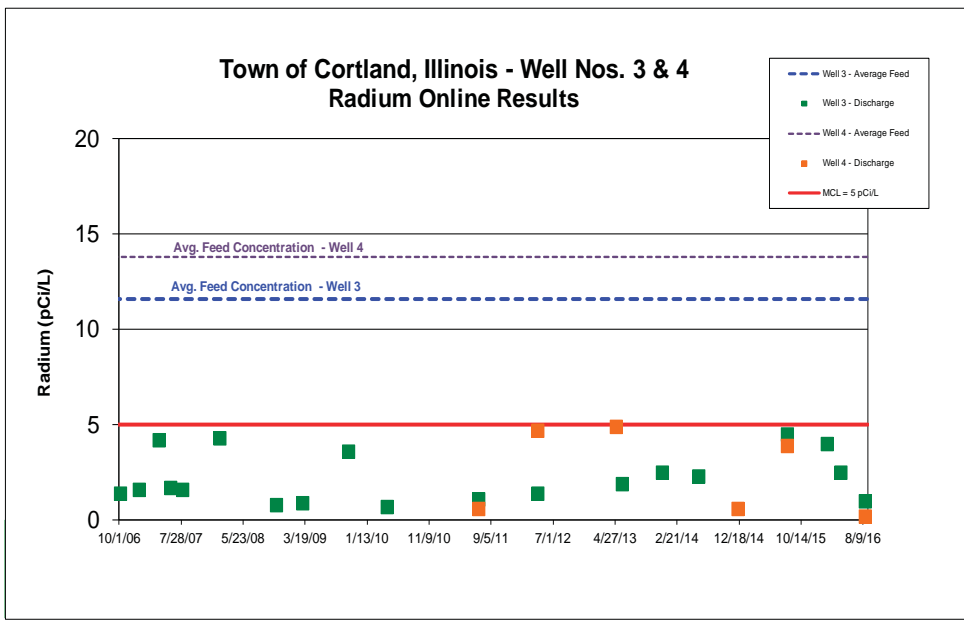

FOR MORE INFORMATION CONTACT:

WRT
 RON DOLLAR
 303.424.5355 OR VISIT:
WWW.WRTNET.COM

TOWN OF CORTLAND
 BOB SEYLLER, MAYOR
 815.756.9041