

INSTALLATION REPORT

Fox Run


Z-92[®] URANIUM REMOVAL

FOX RUN WATER COMPANY
CHESDIN MANOR TREATMENT FACILITY
DINWIDDIE COUNTY, VIRGINIA

Design Flow: 80 GPM

Located 45 miles south of Richmond.
Average uranium levels range from
80 to 91 µg/L. No other treatment, only
the addition of chlorine and polyphosphate.


ON-LINE SYSTEM START DATE:
February 2005

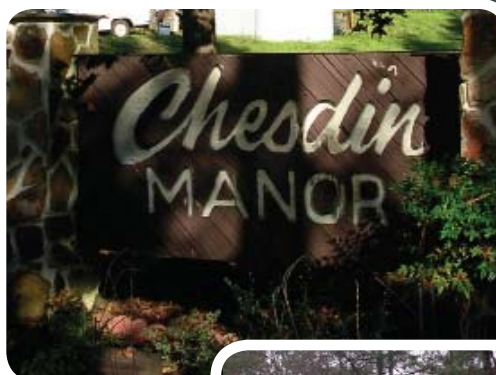

Clean water. Clean earth. That's our promise.®



ON-LINE RESULTS

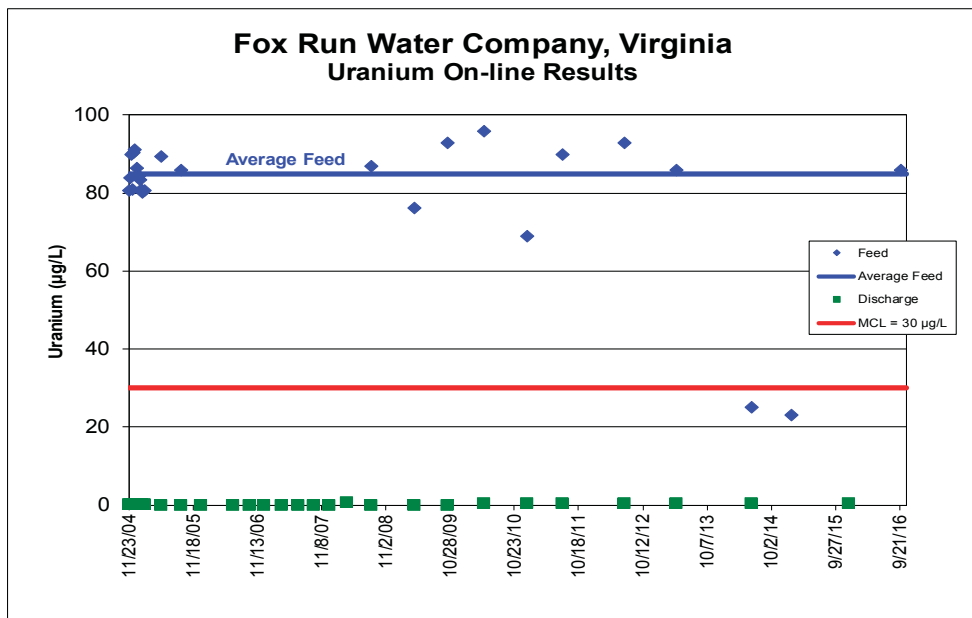

FOR MORE INFORMATION CONTACT:

WRT
RON DOLLAR
303.424.5355 OR VISIT:
WWW.WRTNET.COM

FOX RUN WATER COMPANY
ANDY NASH
434.636.5360