

INSTALLATION REPORT *Keowee Bay*

Z-92[®] URANIUM REMOVAL

KEOWEE BAY HOA
SALEM, SOUTH CAROLINA

Design Flow: 55 GPM

Located in the northwest corner of South Carolina. Average uranium levels approximately 60 µg/L. No other treatment, only the addition of chlorine and polyphosphate.


ON-LINE SYSTEM START DATE:
March 2008



Clean water. Clean earth. That's our promise.®



ON-LINE RESULTS

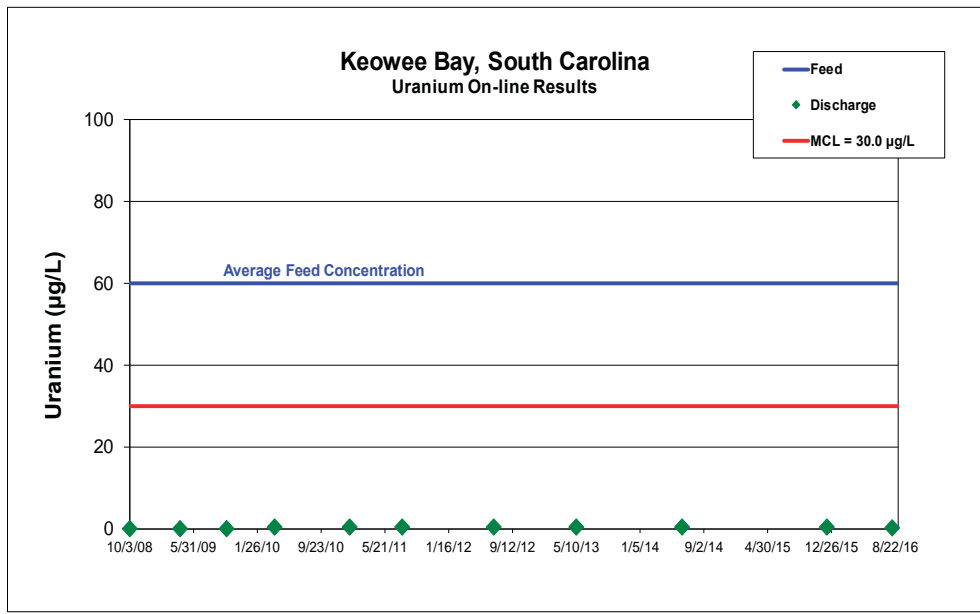

FOR MORE INFORMATION CONTACT:

WRT
RON DOLLAR
303.424.5355 OR VISIT:
WWW.WRTNET.COM

FOX RUN WATER COMPANY
ANDY NASH
434.636.5360