

INSTALLATION REPORT PEWAUKEE

Z-88® RADIUM REMOVAL

CITY OF PEWAUKEE, WISCONSIN

One existing treatment plant

Design Flow: 490 GPM

Located 20 miles west of Milwaukee.
Average radium levels approximately
8.7 pCi/L. No other treatment, only the
addition of chlorine and polyphosphate.

ON-LINE SYSTEM START DATE:


June 2007



Clean water. Clean earth. That's our promise.®



ON-LINE RESULTS

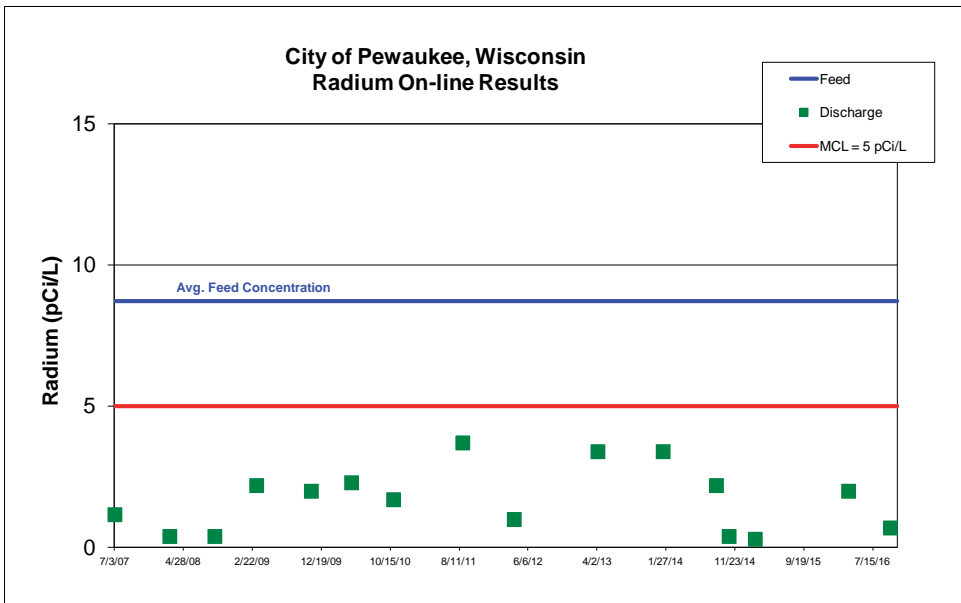

FOR MORE INFORMATION CONTACT:

WRT
 RON DOLLAR
 303.424.5355 OR VISIT:
 WWW.WRTNET.COM

CITY OF PEWAUKEE
 JEFF WEIGEL
 262.691.0804